



BSL NEW ENERGY TECHNOLOGY CO., LTD

User Manual

Li-PRO Series

Document History

Date	Version	Chapter	Description	Author
2024/6/4	V1.0		First Version.	Peng
2025/1/11	V1.1	3.2~3.6	Add a model and change the appearance of all products	Peng
2025/4/15	V1.2	3.2~3.6	change the appearance of all products	Peng
2025/5/27	V1.3	3.2\3.5\3.8	Add battery picture with screen	Peng

Directory

1. Safety Precautions.....	1
1.1 General Safety	1
1.2 General Safety Precautions.....	1
1.3 Battery Handling Guide	2
2 System Application Introduction	3
2.1 PV Self-use Surplus Power to Grid	3
2.2 Peak Shaving and Valley Filling	3
2.3 Standby Power Supply	3
3 Product Specification	4
3.1 System Description	4
3.2 Appearance, Weight and Dimensions	4
3.3 Battery Parameters	5
3.4 Packing List	6
3.5 System Drawing	7
3.6 Interface Description.....	9
3.7 LED Display Definition	10
3.8 On-screen information	11
4 Preparation before Installation.....	13
4.1 Selection of Installation Location	13
4.2 Environment Requirement	13
4.3 Installation Carrier Requirement.....	14
4.4 Clearance Requirement	14
4.5 Tools Requirement	14
4.6 Installation steps.....	15
4.7 Installation Options.....	16
5 Appendix1	17
6 Appendix2	18
7 Appendix3	22
7.1 Abnormal Situation Addressing	22
7.2 Product Responsibilities and Consulting.....	23












1. Safety Precautions

1.1 General Safety





The series rechargeable battery is well designed and tested to meet all applicable states and international safety standards. However, like all electrical and electronic equipment, safety precautions must be observed and followed during the installation of the rechargeable battery to reduce the risk of personal injury and to ensure a safe installation.

Before installing the device, carefully read, fully understand and strictly follow the detailed instruction of the User Manual and other related regulations. And the safety instructions in this document are only supplements to local laws and regulations.

Li-PRO shall not be liable for any consequences caused by the violation of the storage, transportation, installation, and operation regulations specified in this document, including, but not limited to:

-  *Rechargeable battery damage due to force majeure, such as earthquake, flooding, thunderstorm, lighting, fire hazard, volcanic eruption, overvoltage, etc.*
-  *Rechargeable battery damage due to man-made cause*
-  *Rechargeable battery used or operated against any items in local policy*
-  *Failure to follow the operation instructions and safety precautions on the product and in this document*
-  *Installation and use under improper environment or electrical condition*
-  *Unauthorized modifications to the product or software*
-  *Rechargeable battery damage caused during transportation by the customer*
-  *Storage conditions that do not meet the requirements specified in this document*
-  *Failure to adequately maintain the equipment. An on-site inspection should be carried out by a qualified technician after 120 months of continuous use. If more than 120 months have been passed since the date of commissioning, or the user cannot prove that the equipment has been adequately maintained*
-  *Use of incompatible inverters or devices*
-  *Installation and commissioning operated by unauthorized personnel who are not licensed and /or satisfy state and local jurisdiction regulations.*

1.2 General Safety Precautions

-  *Overvoltage or wrong wiring may damage the battery pack and cause combustion which may be extremely dangerous.*
-  *Leakage of electrolytes or flammable gas may occur due to any type of product breakdown.*
-  *Do not install the battery pack in places where flammable and combustible materials are stored, and in which an explosive atmosphere is present.*
-  *The battery pack wiring must be carried out by qualified personnel.*

- ✚ *Battery pack must be serviced by qualified personnel.*
- ✚ *Ensure that the grounding cable is connected before handling the battery pack.*

1.3 Battery Handling Guide

DO THINGS:

- ✚ *DO keep the battery pack away from flammables materials, heat sources, and water sources.*
- ✚ *DO keep the battery pack out of reach of children and animals.*
- ✚ *DO practice proper battery storage by keeping the battery pack in a clean environment, free of dust, dirt and debris.*
- ✚ *DO store the battery pack in a cool and dry place.*
- ✚ *DO seal the outer cable connection hole to prevent ingress of foreign objects.*
- ✚ *DO confirm that the wiring of the device must be correct.*
- ✚ *DO install the device according to the local standards and regulations.*

DON'T DO THINGS:

- ✚ *DON'T expose the battery pack to an open flame, or the temperature more than 140°F/60°C.*
- ✚ *DON'T store or install the battery pack in direct sunlight.*
- ✚ *DON'T install or operate the battery pack in places where there is excessive moisture or liquids.*
- ✚ *DON'T place the battery pack in a high voltage environment.*
- ✚ *DON'T disconnect, disassemble or repair the device by unqualified personnel. Only qualified personnel are allowed to handle, install and repair the device.*
- ✚ *DON'T damage the device by dropping, deforming, impacting, cutting or penetrating with a sharp object. Otherwise, it may cause a fire or leakage of 3 Safety electrolytes; DON'T touch the device if liquid spills on it. There is a risk of electric shock.*
- ✚ *DON'T step on the packaging or the device may be damaged.*
- ✚ *DON'T place any objects on top of the battery pack.*
- ✚ *DON'T charge or discharge a damaged battery pack.*
- ✚ *DON'T dispose of the battery pack in a fire. It may cause leakage or rupture.*
- ✚ *DON'T mix different types or makes of battery pack. It may cause leakage or rupture, resulting in personal injury or property damage.*

⚠ WARNING!

- Do not crush or impact battery, and always dispose of it according to relevant safety regulations.
- The battery pack may catch fire when heated above 150°C/302°F.
- In case of catching fire, the battery pack will produce noxious and poisonous gases, and please keep away the battery.
- Damaged batteries may leak electrolyte or produce flammable gas. If users suspect that the battery is damaged, please immediately contact SolaX for advice and information.
- All operations of T-BAT-SYS-LD relating to electrical connection and installation must be carried out by qualified personnel.

⚠ CAUTION!

- If the battery pack is not installed within a month after receipt, it must be charged for maintenance. Non-operational batteries should be discarded according to the local regulations.

2 System Application Introduction

This product is a household energy storage battery pack. The system is composed of a 5.1kwh/10.5kwh lithium iron phosphate battery pack.

This product can be used in conjunction with electricity, so that electricity consumption can be adjusted.

This product supports a variety of application modes, such as PV self-use surplus power to grid, peak shaving and valley filling, standby power supply, etc. The specific operation logic is as follows.

2.1 PV Self-use Surplus Power to Grid

Under the condition of good illumination in the daytime, the DC power from PV panel is changed into AC through inverter to supply power for household load. If the household load cannot run out of photovoltaic power, the remaining power will be stored in the battery. If the battery is full, photovoltaic power will be supplied to the grid. In the night or rainy days, photovoltaic cannot generate electricity. The battery supplies power to the home load through an inverter. If the battery SOC is low, the household load will take power from the grid.

2.2 Peak Shaving and Valley Filling

In some countries and regions where peak valley time of use price is implemented, if the difference between peak price and low price is large, the application mode of peak shaving and valley filling can be adopted in energy storage system. In the low electricity price period, the energy storage system is charged, in the peak period of electricity price, the energy storage system supplies power to the household load. It can prevent users using too much power grid when the electricity price is high and save energy expenditure.

2.3 Standby Power Supply

In some extreme weather (such as tornadoes, typhoons, hail), or substation operation failure, power supply will be interrupted. If the energy storage system is installed, the user can still enjoy

sufficient power guarantee under this situation.

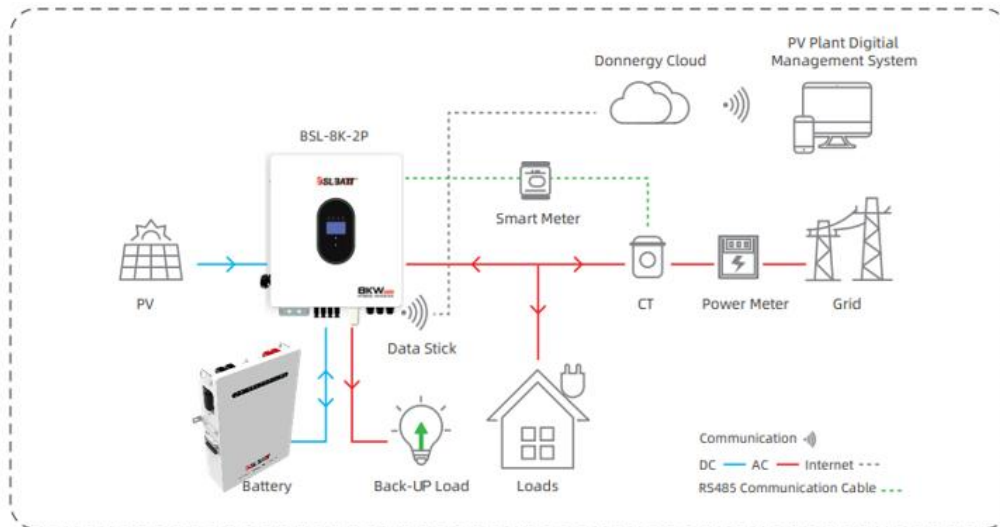


Figure 1. System Connection Diagram


3 Product Specification

3.1 System Description

The battery system consists of one or more rechargeable batteries. A battery pack is a type of electrical battery which can charge or discharge loads. There are two installation options, such as floor mounting and wall mounting, that a user can select from.

3.2 Appearance, Weight and Dimensions

Appearance:

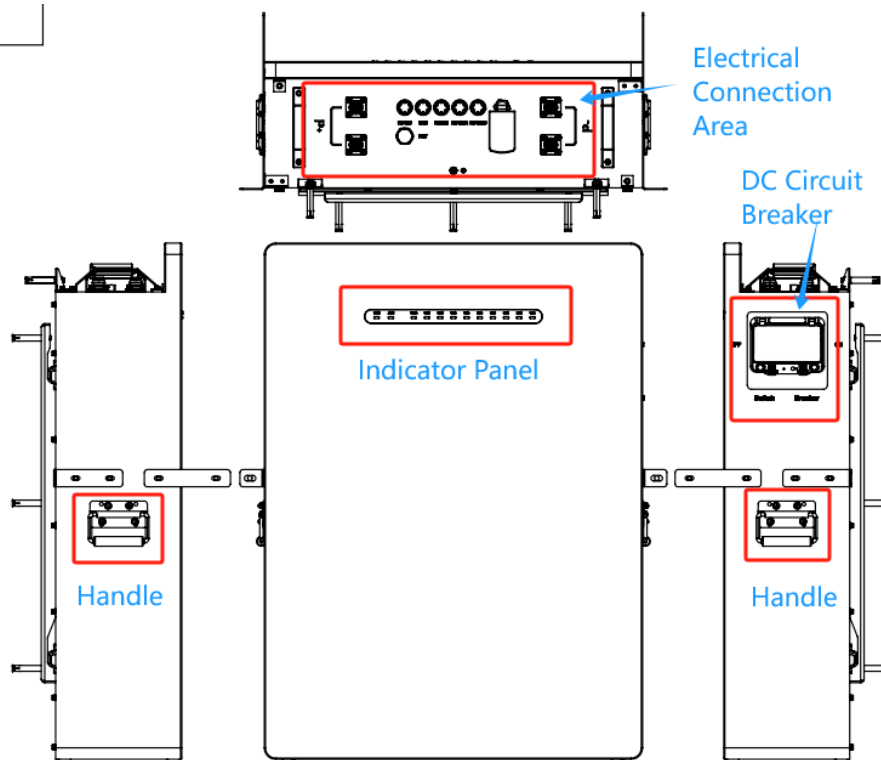

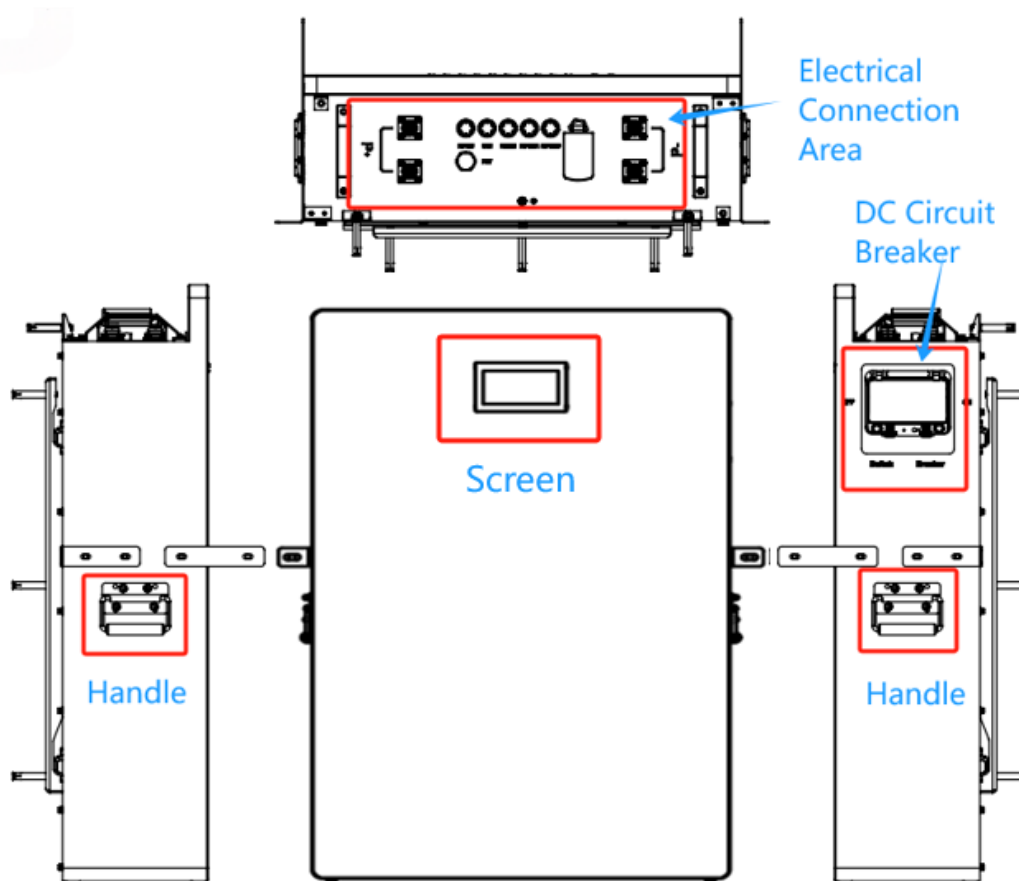


Table 2-1 Description of appearance

N	Item	Description
1	Electrical connection area	Including BAT+/BAT- ports, communication port, BMS port. Please refer to “Electrical Connection Area” for details.
2	Indicator panel/Screen	Provide two different types of human-readable indication of an instrument signal. For details, please refer to “ 3.7 LED Display Definition ” and “ 3.8 On-screen information ”.
3	DC Circuit Breaker	Including an air switch for automatically protection when current over limitation and a metal switch for power on the BMS.
4	Wi-Fi Module	Configure WIFI password to battery by phone Bluetooth and can monitor details and configure parameters of battery by cloud platform.
5	Handle	Lift the battery conveniently.

Weight and Dimensions:


Table 2-2 Weight and dimensions of a battery pack

N	Model	Li-PRO 5120	Li-PRO 10240	Li-PRO 15360
1	Length(mm)	660	760	900
2	Width(mm)	450	530	660
3	Height(mm)	145	190	220
4	Net weight(kg)	54	96	133

3.3 Battery Parameters

N	Item	Li-PRO 5120		Li-PRO 10240	Li-PRO 15360		
1	Nominal Voltage	51.2V					
2	Rated Capacity	100Ah	102Ah	206Ah	280Ah	300Ah	306Ah
3	Cell Model (LFP-3.2V)	100Ah	102Ah	206Ah	280Ah	300Ah	306Ah
4	Pack configuration	16S1P	16S1P	16S1P	16S1P	16S1P	16S1P
5	Rate power (Wh)	5120	5222.4	10547	14336	15360	15667
6	Charging Voltage	55V					
7	Float charge Voltage	54.5V					
8	Discharge Cut-off Voltage	47V					
9	Rated Current	40A		80A			
10	Max Continuous Charge Current	80A		160A			
11	Max Continuous Discharge Current	100A		200A			
12	Pack Weight (Kg)	54		96	133		
13	Internal Impedance	≤100mΩ					
14	Communication protocol	CAN/RS485					
15	Host software and Communication	RS232					
16	Operation Temperature Range	Charge:0~55℃					
17	Operation Temperature Range	Discharge: -20~60℃					
	Storage conditions Range(recommend)	20%~40% SOC, 0℃~35℃, humidity≤60%					
18	Storage conditions	20%~40% SOC, 0℃~35℃, humidity≤60%					

3.4 Packing List

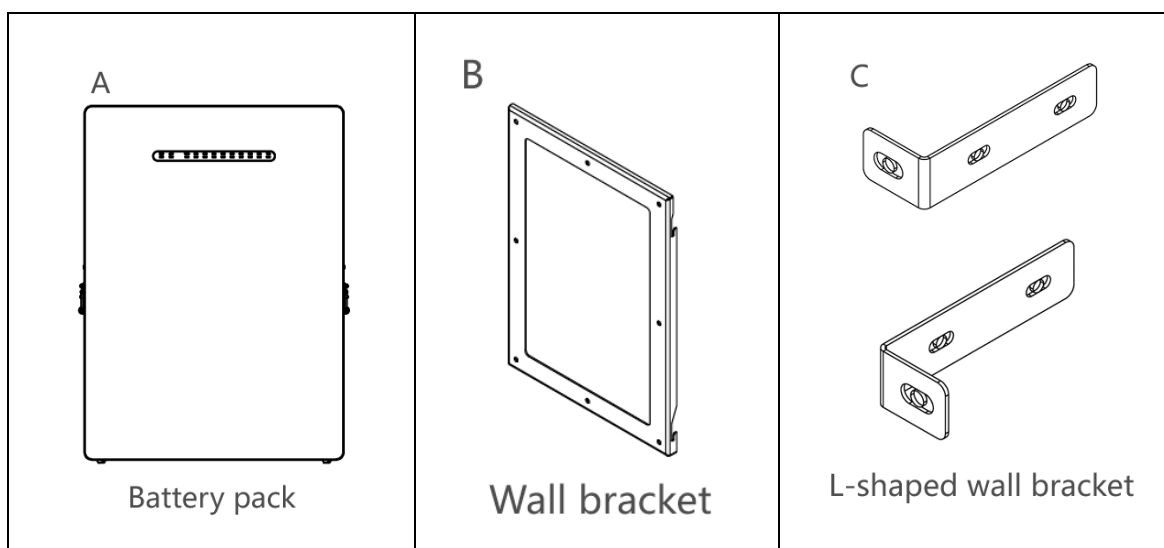







<p>D</p>  <p>Parallel brackets</p>	<p>E</p>  <p>Expansion bolts</p>	<p>F</p>  <p>Power cable (red) (1500 mm)</p>
<p>G</p>  <p>Power cable (black) (1500 mm)</p>	<p>H</p>  <p>Universal inverter communication cable(black) (1500 mm)</p>	<p>I</p>  <p>Victron inverter communication cable(black) (1500 mm)</p>




Table: Packing list of battery pack

Item No.	Description	Quantity (Unit: pcs)
A	Battery pack	1
B	Wall bracket	1
C	L-shaped wall brackets	2
D	Parallel brackets	2
E	Expansion bolts	10
F	Power cable (red) (1500 mm)	1
G	Power cable (black) (1500 mm)	1
H	Universal inverter communication cable(black) (1500 mm)	1
I	Victron inverter communication cable(black) (1500 mm)	1

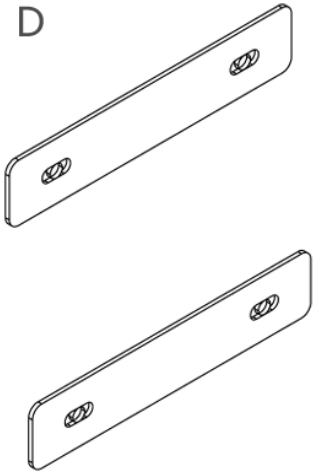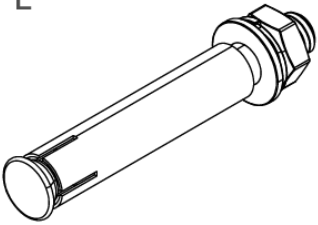3.5 System Drawing

Li-PRO series

Li-PRO 5120	Li-PRO 10240	Li-PRO 15360
 	 	 
		

		
Product size: 660*450*145mm	Product size: 760*530*190mm	Product size: 900*660*220mm

3.6 Interface Description

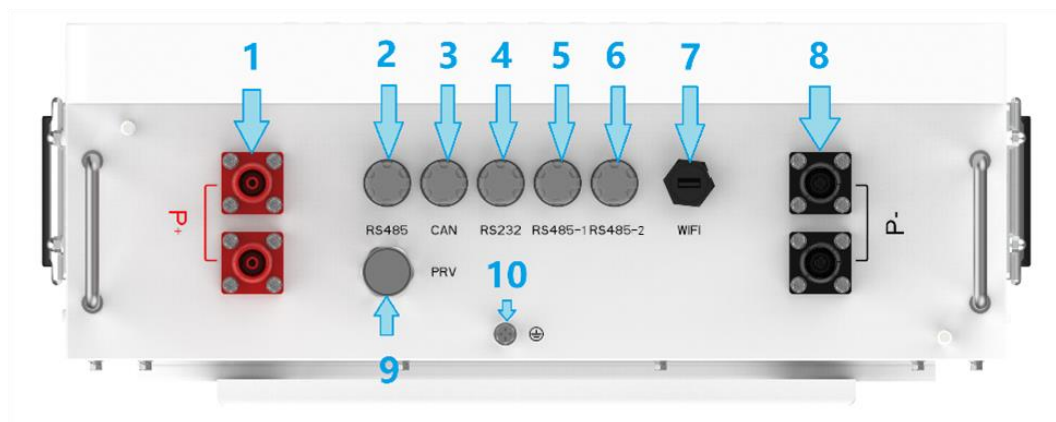



Figure 2

Table1.Battery Pack Front Panel Port Definition

No.	Illustration	Silk-screen	Remark
1	Battery positive post	P+	positive output
2	RS485 Port	RS485	RS485 communication with PCS
3	CAN bus port	CAN	CAN bus and inverter connection ports
4	RS232 port	RS232	communication port for computer monitoring
5	RS485-1 port	RS485-1	battery paralleling communication port

6	RS485-2 port	RS485-2	battery paralleling communication port
7	Wi-Fi stick socket	WIFI	If the Wi-Fi function is selected, it can be used to plug in the Wi-Fi dongle
8	Battery negative post	P-	negative output
9	Pressure Release Valve	PRV	When thermal runaway occurs, it is used to release the harmful gases produced
10	Grounding point	PE	It is used to export static electricity in the system

3.7 LED Display Definition

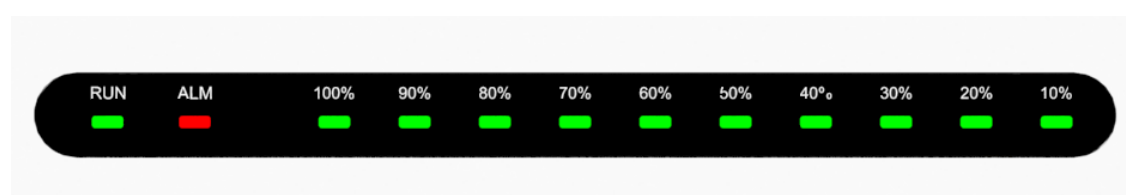



Run-Led	Alarm-Led	Led-10	Led-9	Led-8	Led-7	Led-6	Led-5	Led-4	Led-3	Led-2	Led-1
RUN	ALM	Capacity indicator light									
		100%	90%	80%	70%	60%	50%	40%	30%	20%	10%




Table 2 LED Working Status Indicators


Status	Normal/Alarm /Protection	RUN	ALM	Electricity indicator LED									
		●/●	●/●	●/●	●/●	●/●	●/●	●/●	●/●	●/●	●/●	●/●	●/●
Power off	Dormancy or Undervoltage	off	off	off	off	off	off	off	off	off	off	off	off
Standby	Normal	●Bright	off	According to the electricity indicator									
	Alarm or SOC<20%	●Bright	●Flash										
Charge	Normal	●Flash	off	●Turning blue According to the electricity indicator (Remaining SOC LED flowing affect)									
	Alarm	●Flash	●Flash										
	Protection	●Flash	●Flash										
Discharge	Normal	●Flash	off	●Turning green According to the electricity indicator									
	Alarm	●Flash	●Flash										

	Protection	●Flash	●Flash	(Flashing once every 2 seconds)									
Invalid	Normal	off	●Bright	off	off	off	off	off	off	off	off	off	off

3.8 On-screen information

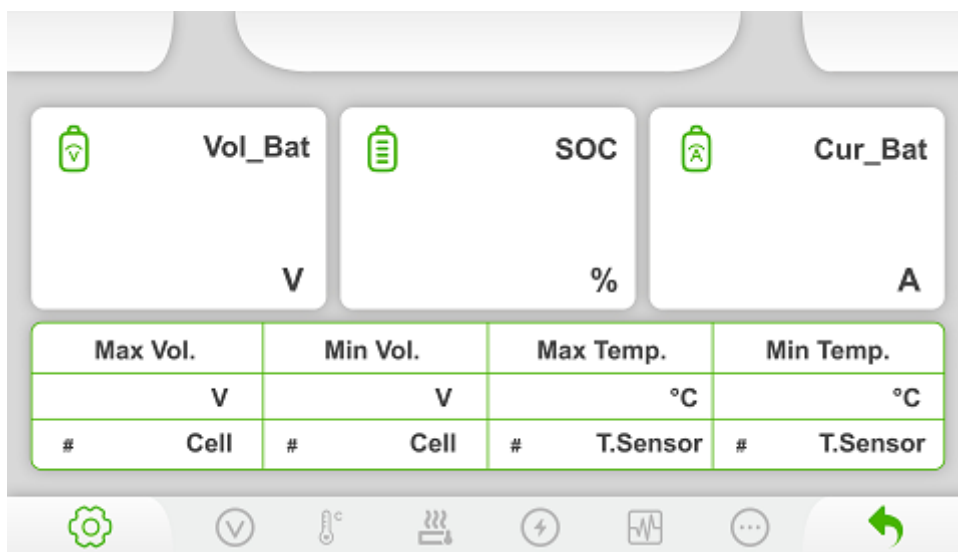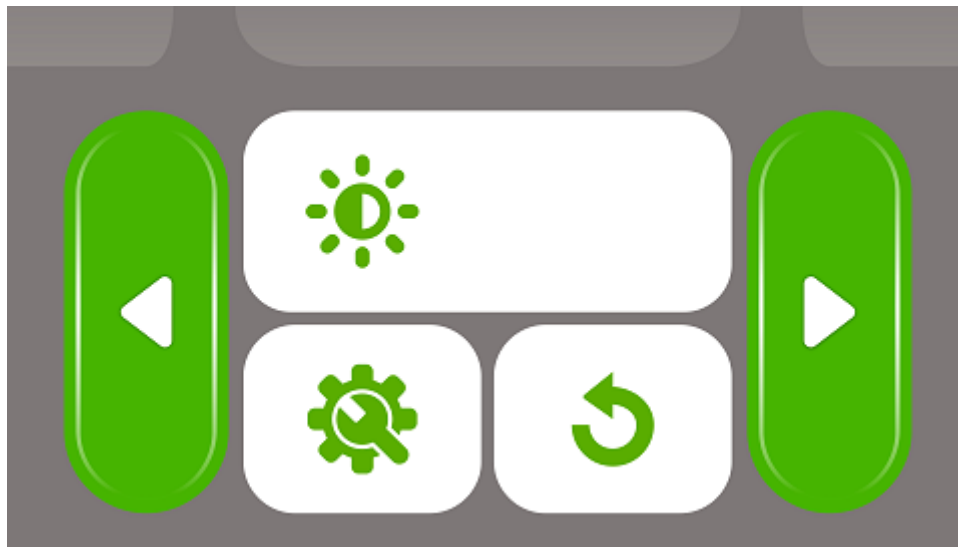

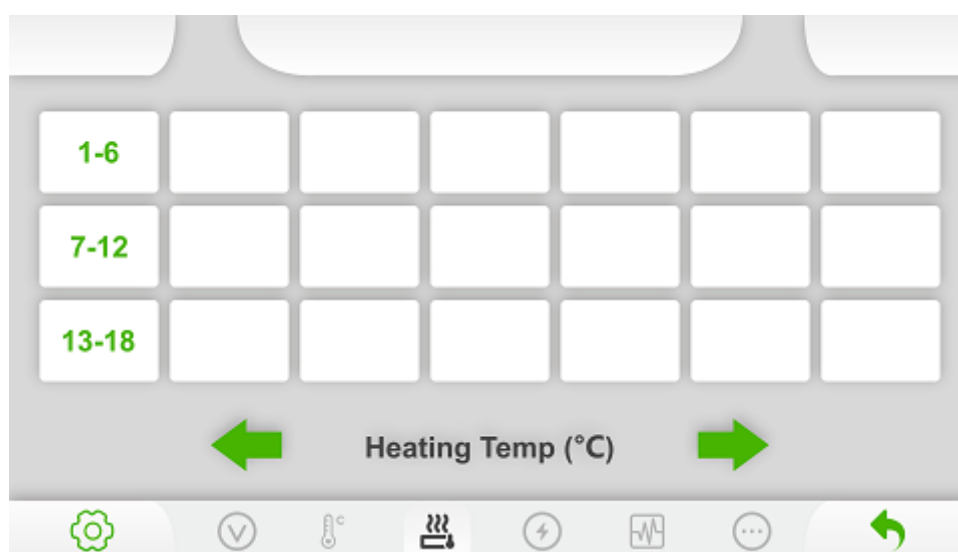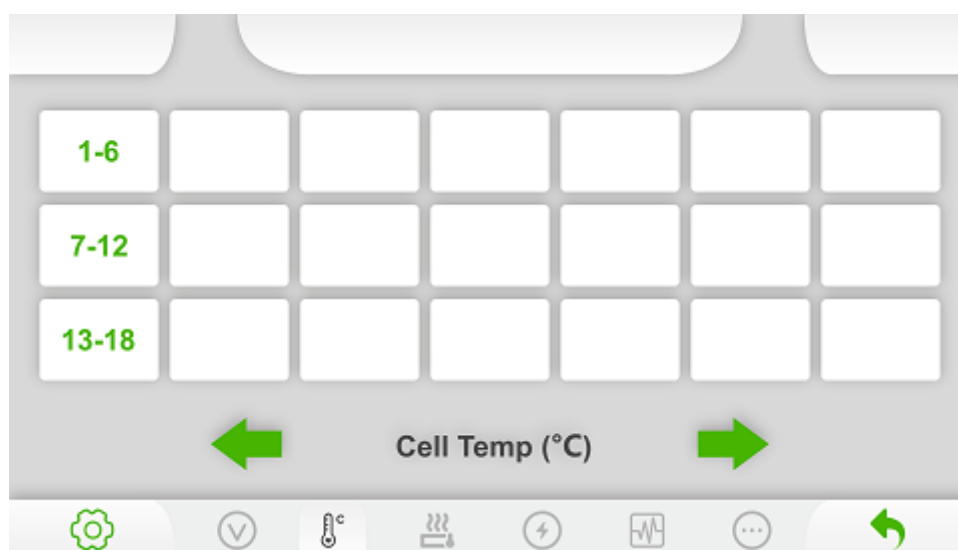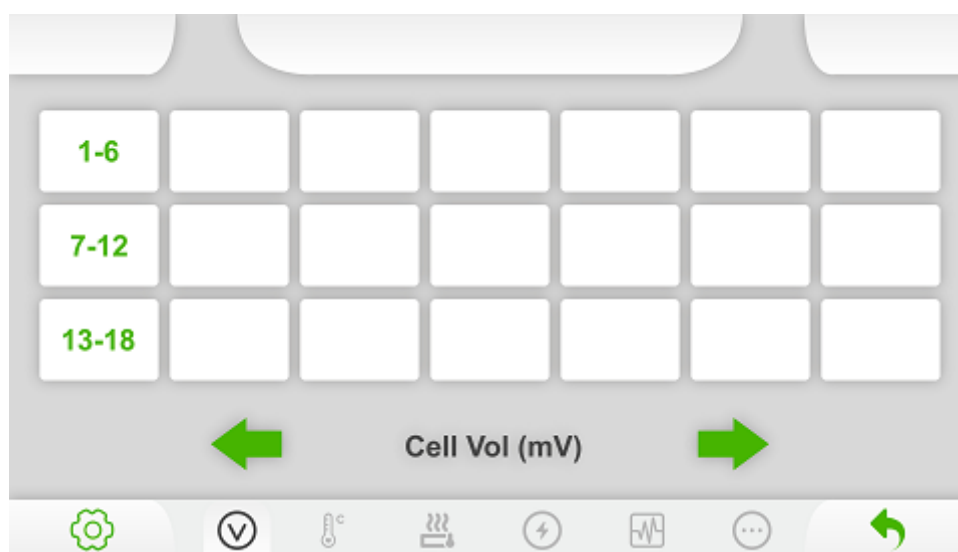

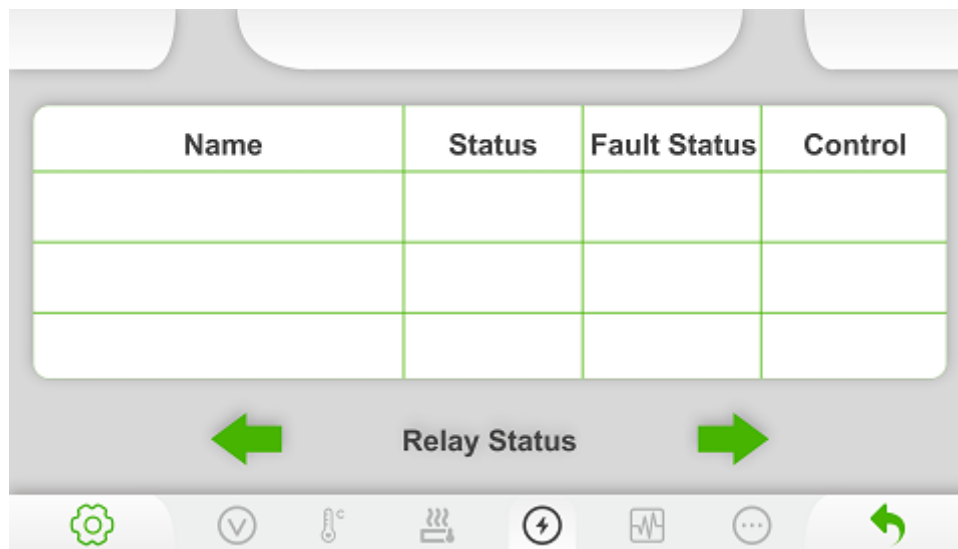

4 Preparation before Installation

4.1 Selection of Installation Location


The installation location selected for the rechargeable battery is quite critical in the aspect of the guarantee of machine safety, service life and performance.

- ✚ It has the IP65 ingress protection, which allows it to be installed outdoor.
- ✚ Before installing the battery system, lay out available floor space or wall space including aisles for installation, maintenance and possible battery pack replacement.

4.2 Environment Requirement

Make sure the installation site meets the following conditions:

- ✚ The operating temperature: -20°C to +53°C.
- ✚ The humidity shall be between 5-95%.
- ✚ Do not install the rechargeable battery in the areas where the altitude exceeds 2000 m.
- ✚ Install the rechargeable battery in a well-ventilated environment for heat dissipation.
- ✚ Do not install rechargeable batteries in areas with flammable, explosive and corrosive materials.
- ✚ Do not install rechargeable batteries in areas near combustibles and antenna.
- ✚ You are recommended to install an awning over it. Direct sunlight, rain exposure and snow laying. up is not allowed.

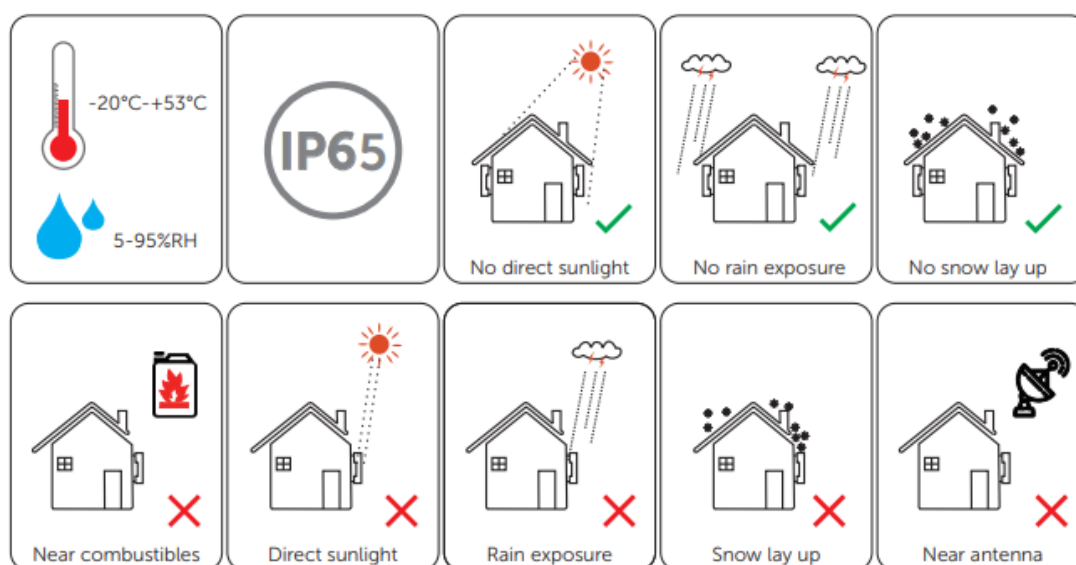

4.3 Installation Carrier Requirement

The mounting location must be suitable for the weight and dimensions of the product and the support surface for installation must be made of a non-flammable material:

- ✚ Solid brick/concrete.
- ✚ Either floor mounting or wall mounting, the bearing capacity of the area to place or install a battery pack must be over 200 kg.
- ✚ Please ensure that the thickness of any part of the wall should not be less than 100 mm.
- ✚ The device must not be installed on the wood wall.


4.4 Clearance Requirement

To guarantee proper heat dissipation and ease of disassembly, the minimum space around the rechargeable battery must meet the standards indicated below:

- ✚ No matter which floor mounting or wall mounting is chosen, a distance between 200 and 300 mm wide shall be provided from the wall to the edge of the battery pack.
- ✚ No matter which floor mounting or wall mounting is chosen, a distance between 400 and 600 mm wide shall be provided from the left side edge of a battery pack to the right-side edge of the neighboring battery packs.
- ✚ In the case of floor mounting, 55 mm shall be provided from the rear side of the battery pack to the wall.
- ✚ In the case of wall mounting, the distance between 300 and 350 mm shall be provided from the grounding to the bottom of the battery pack.

4.5 Tools Requirement

Installation tools include but are not limited to the following recommended ones. If necessary, use other auxiliary tools on site.

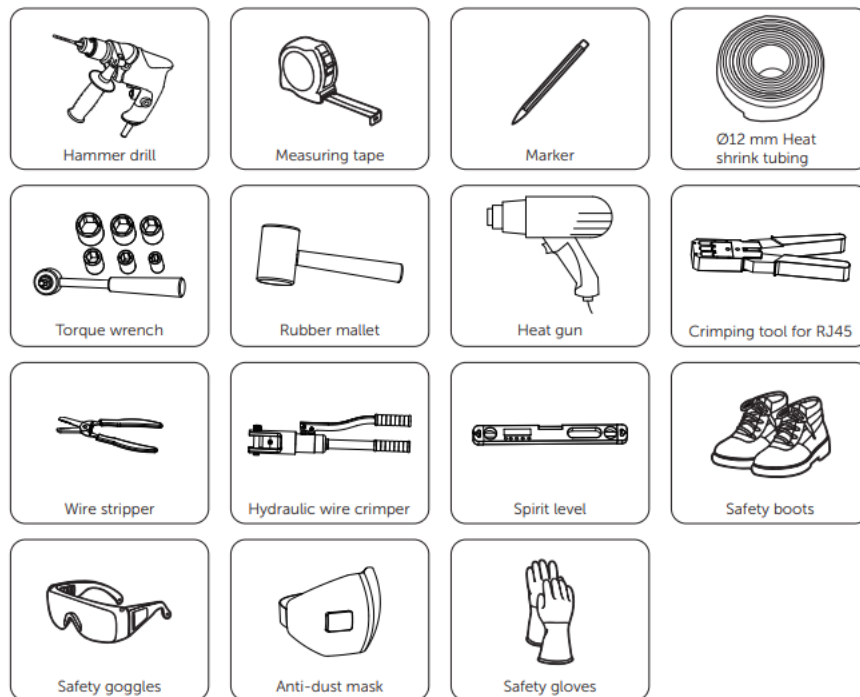

4.6 Installation steps

Unpacking:

- The rechargeable battery undergoes 100% testing and inspection before shipping from the manufacturing facility. However, transport damage may still occur. Before unpacking the rechargeable battery, please verify that the model and outer packing materials for damage, such as holes and cracks.
- Unpacking the battery pack according to the following figures. If there are other cartons, such as the rack carton, cabinet carton, cables carton, or cartons about wall mounting, the unpacking procedure can also be referred to the following figures.

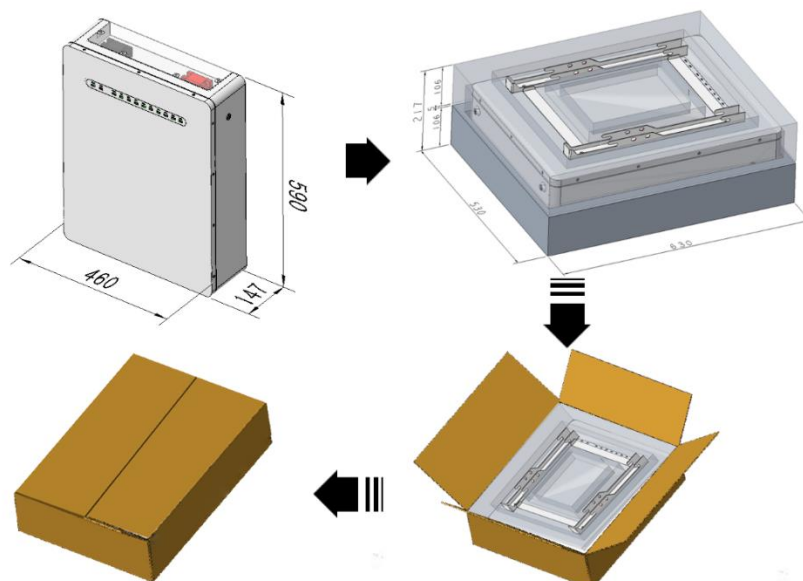


Figure: Unpacking the battery pack

- ✚ Be careful when dealing with all package materials which may be reused for storage and relocation of the rechargeable battery in the future.
- ✚ Upon opening the package, check whether the appearance of the rechargeable battery is damaged or lack of accessories. If any damage is found or any parts are missing, contact your dealer immediately.

4.7 Installation Options

There are two installation options (floor mounting and wall mounting) are available, with details as follows:

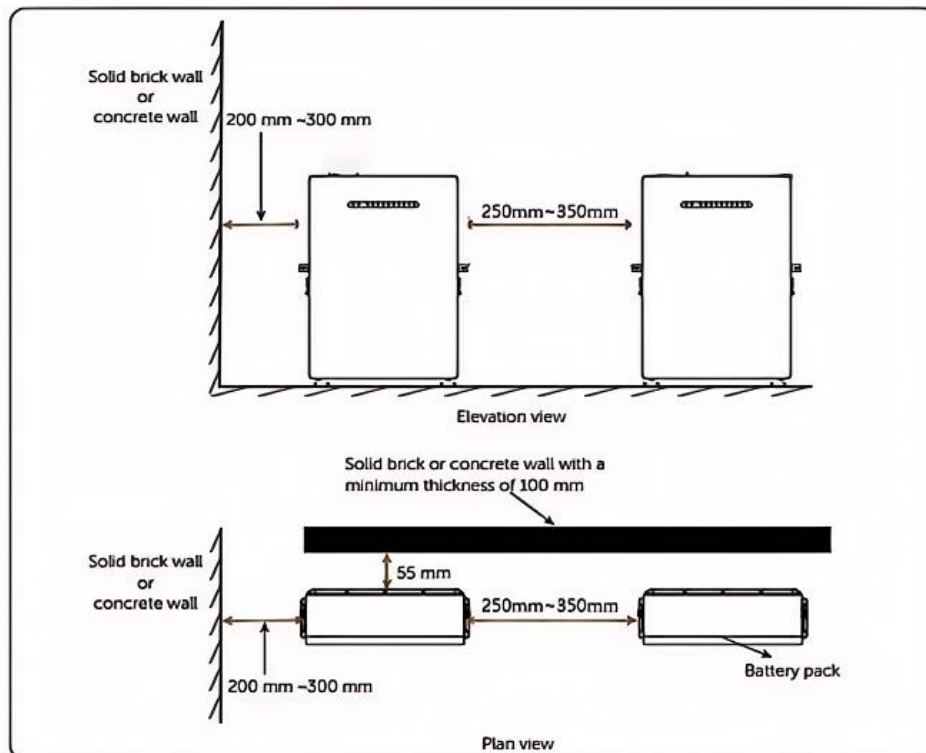


Figure: Clearance requirement about floor mounting

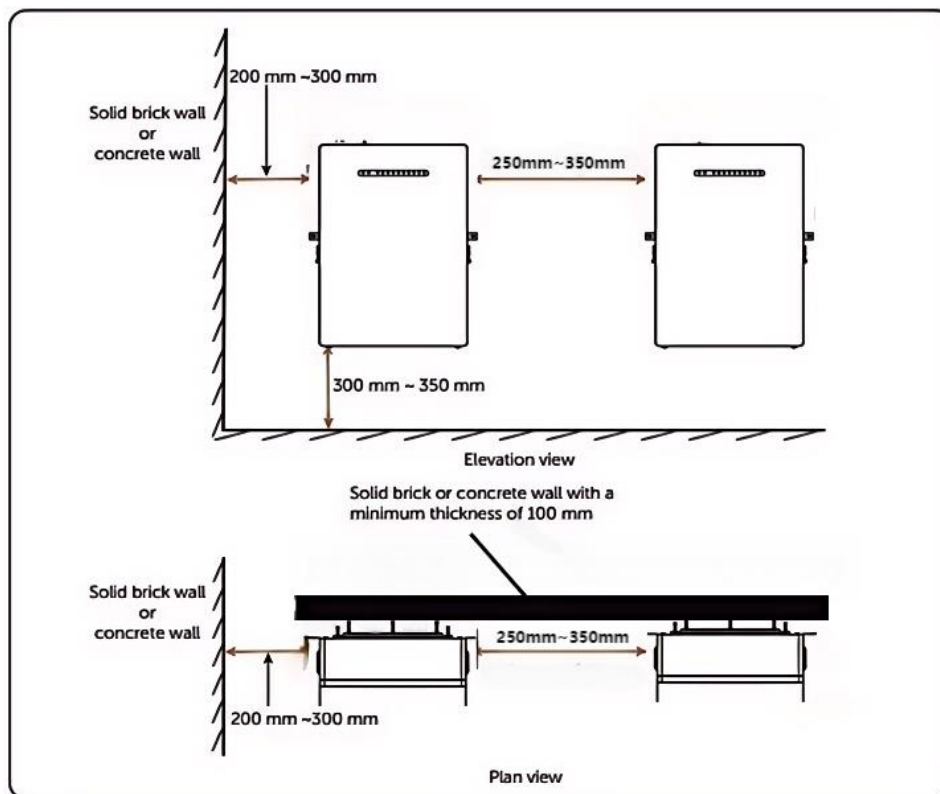


Figure: Clearance requirement about wall mounting

WARNING

CAUTION. Please read all safety precautions and users manuals before use or operation.

WARNING: Risk of Fire explosion or burns:

- DO NOT short the battery terminals.
- DO NOT incinerate crush or disassemble.
- DO NOT over charge or over discharge.
- DO NOT reverse connections (polarity) from charge to battery.
- DO NOT operate battery beyond published voltage current and temperature limits.



Note: when a single unit is used, the inverter uses the battery as the main machine to communicate; when multiple batteries are used in parallel, the batteries inside are connected in parallel through the RS485-1/2 hardware interface, RS485/CANBUS communicates with the inverter.

5 Appendix1

When the equipment manufacturer confirms that it is necessary, it can authorize to provide the

customer with the host software and operating instructions.

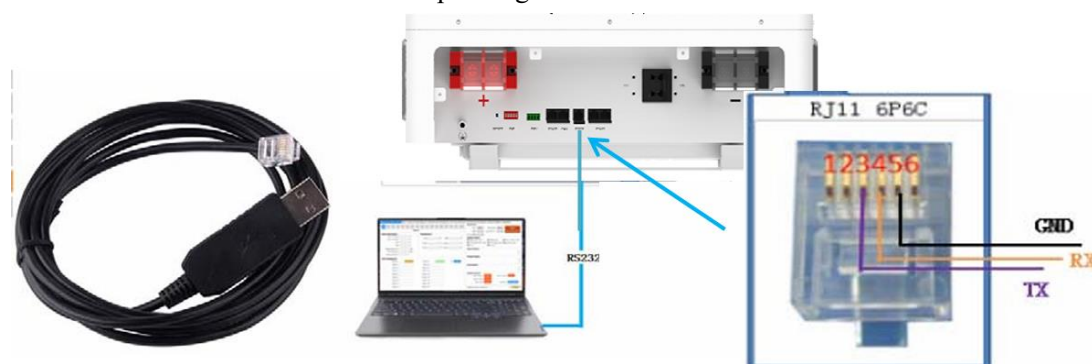


Figure 7 RS232 Serial port communication device

Host soft operation:

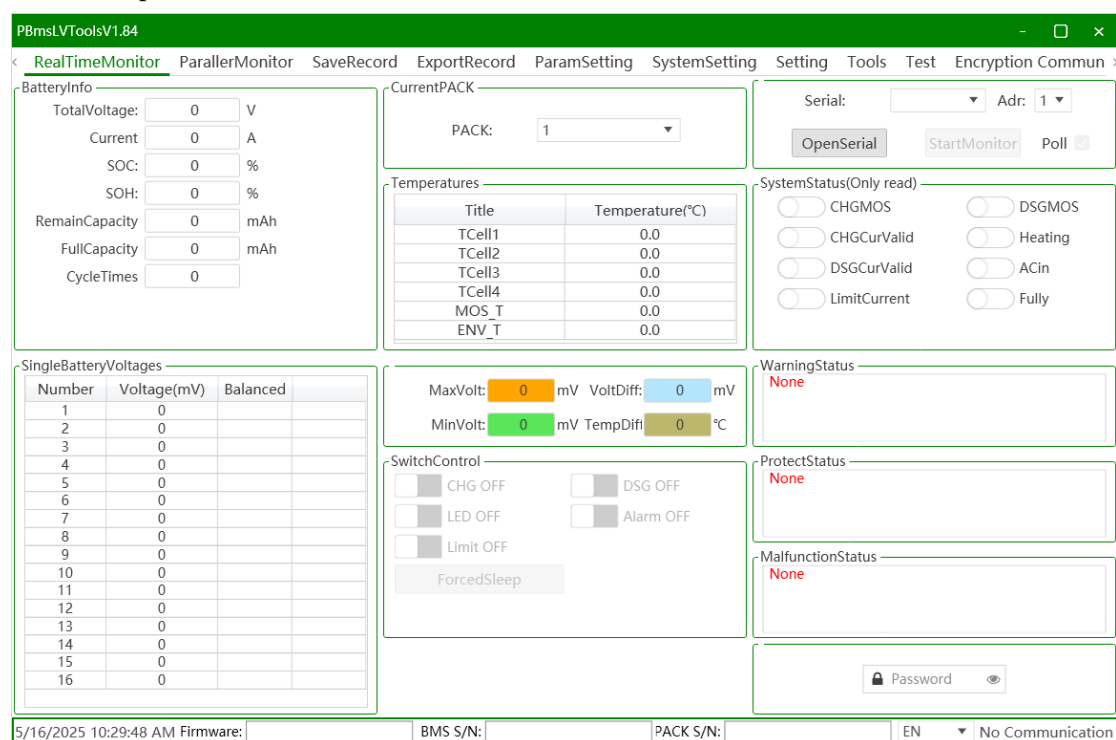












Figure 8

6 Appendix2




Multi Inverter protocol support:

NO	Type	Inverter		Protocol
1	CAN	Pylon		PYLON CAN LV V1.3-2019.03.01
2		DEYE/Sunsynk		PYLON CAN LV V1.3-2019.03.01


3	Growatt		Growatt CAN LV V1.09-2020.10.22
4	Victron		Victron CAN 2021.01.07
5	Luxpower		Luxpowertek CAN V1.0-2020.02.11
6	SMA		SMA CAN V2.0
7	Goodwe		GoodWe CAN Inverter LV V1.7-2020.02.28
8	Studer		STUDER CAN V1.02-2018.06.14
9	Sofar		SofarSolar CAN inverter V6
10	Ginlong/Solis		GINLONG CAN LV V1.0-2019.12.28
11	TBB_LITHIUM		TBB CAN V1.05-2021.04.20
			TBB CAN V1.1-2021.10.21
12	Daneng		DANENG CAN V10-2022.10.10
13	Aiswei		AISWEI CAN V1.0
14	SAJ		SAJ CAN V1.9-2022.06.30
	Sorotec		Sorotec CAN Inverter V1.22-2017.11.28
15	MUST		MUST CAN V2.0.2-2021.06.02
16	Megarevo		PYLON CAN LV V1.3-2019.03.01
17	Schneider		Schneider can2.0
18	Afore		Afore Communication protocol CAN

19		Solax		PYLON CAN LV V1.3-2019.03.01
----	--	-------	---	------------------------------

1	RS485	Pylon		PYLON RS485 LV-BPB V3.5-2019.08.07
2		DEYE/Sunsynk		PYLON RS485 LV-BPB V3.5-2019.08.07
3		Growatt		Growatt RS485 V2.01-2019.02.13
4		Voltronic		Voltronic RS485 Inverter V1.0-2018.09.11
5		Phocos		Phocos RS485 2021.04.07
6		Luxpower		Luxpowertek RS485 inverter V0.3-2020.07.06
7		SRNE		WOW RS485 Modbus V1.3-2017.06.27
8		Sorotec		Sorotec RS485 Inverter V1.22-2017.11.28
9		Hypon		HYPONTECH RS485 Modbus V2.0-2023.06.29
10		SUNPLA IN		Communication protocol for 8-11KW energy storage inverters
11		Epever		Lithium Battery BMS-Link Communication Address Table V1.6
12		TALEGE NT		B Communication Protocol from Inverter to BMS
13		ELTEK		BatteryModbusDataDefinitions (REV14)
14		Techfine		PYLON 485 Communication Protocol V3.5
15		SMKSOLAR		Lithium Battery Agreement GT Version 24 Year 7 1.0 Version

16	Gospower		PYLON 485 Communication Protocol V3.5
17	AOHAI		PYLON 485 Communication Protocol V3.5
18	SUNGER Y		PYLON 485 Communication Protocol V3.5


Default setting: CANBUS - Victron, RS485-DEYE.



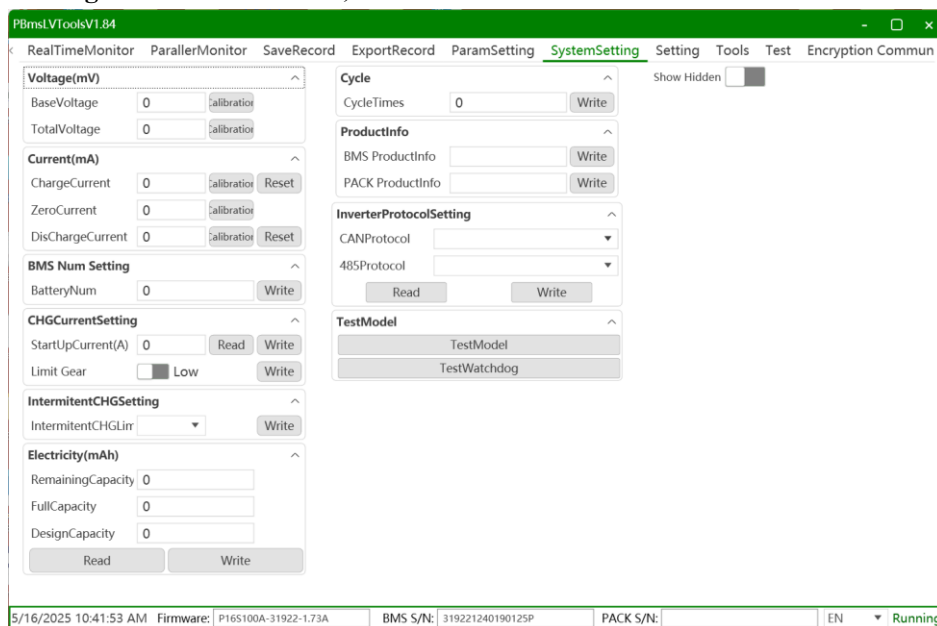


Remark:

- Please ask your sales team to provide password for host computer software administration enter.
- Different inverters the pin assignment is not the same, please contact inverter supplier for detailed RJ45 cables of pin assignment.

Connector pin configurations for the above-mentioned inverter manufacturers are listed below:

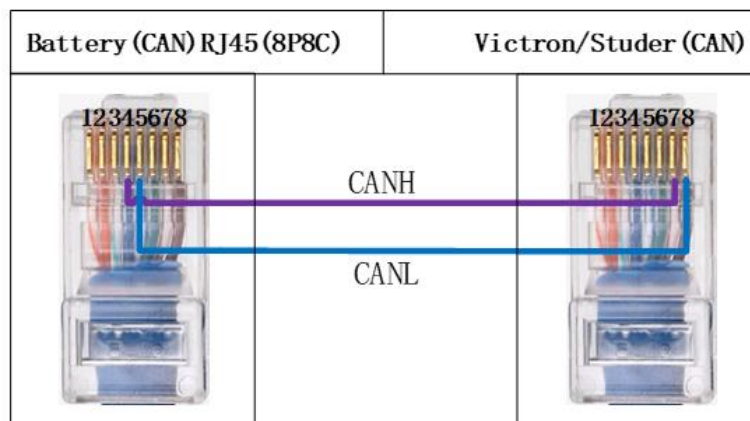

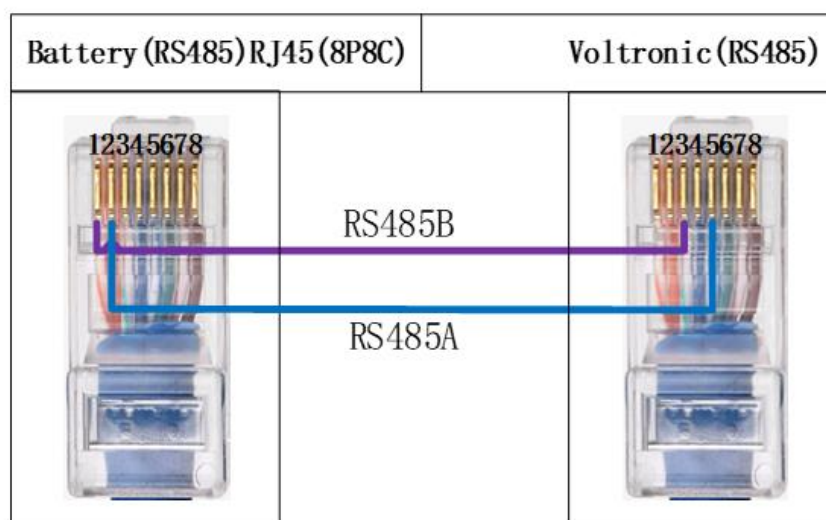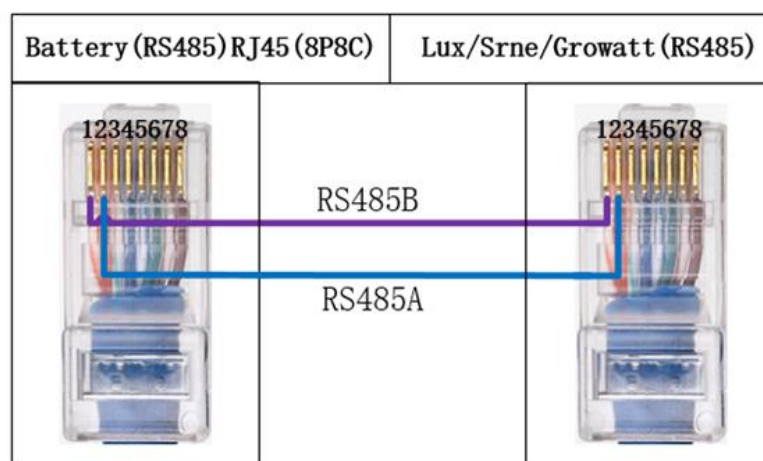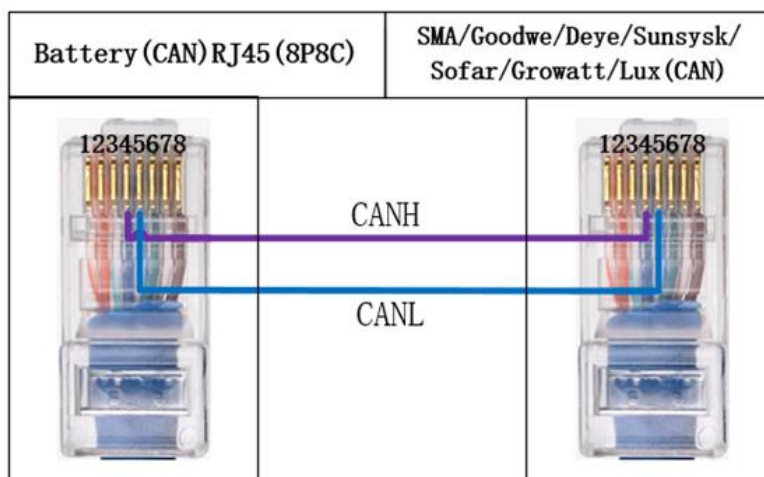

7 Appendix3

7.1 Abnormal Situation Addressing

1.What if the battery pack does not work properly after it is powered on?

A: The most direct way is to connect to the upper computer, through the upper computer to find the fault phenomenon, causes can be roughly analyzed from the upper computer interface prompt alarm, protection, fault, and other information, it can also provide necessary reference for further testing.

2. Under what circumstances will RS232 communication fail?

A: The following steps can be taken to eliminate the problem:

- 1) Confirm that at least one of the indicator lights of the battery pack is on or flashing, that is, the battery pack is in normal working condition.
- 2) Confirm that the host computer software selects correct COM port (view device manager);
- 3) Confirm whether the RS232 communication line is fully inserted into the corresponding communication interface of the battery pack.

3. Under what circumstances will RS485 fail to parallel batteries communication?

A: The possibility of failure of parallel batteries communication is as follows: first ensure whether the parallel RS485 communication port has been connected and then make sure that the address dialing position of the battery pack is correct, and make sure that the RS485 terminal Plug-in in the right place.

4. What is the fault alarm mechanism?

A: battery pack has fault alarm function, can be checked through upper computer software.

Failure includes:

- 1) Sampling failure: analog front-end and main control chip communication failure. When the fault occurs, the charge and discharge function is turned off, and the fault alarm can be automatically cleared after the fault is cleared.
- 2) Temperature NTC failure mainly detects whether the temperature NTC is short-circuited or disconnected. When the fault occurs, the charge and discharge function is turned off, and the fault alarm can be automatically cleared after the fault is cleared.
- 3) Cell failure: the voltage difference of the cell exceeds 1V, or the difference between the total voltage detection voltage and the sum of single cell voltage is more than 5V, or the minimum voltage is less than 0.5V. The voltage sampling line disconnect also reports the same fault. When the fault is cleared, the fault alarm can be automatically cleared.

After the battery is connected to the system and shows over-current protection or short circuit protection. This is not a problem with the battery pack, but the capacity load of the electrical equipment is too large. Charging can remove the alarm or extend the battery pack pre-charge circuit delay time.

7.2 Product Responsibilities and Consulting

We will not be liable for the accidents resulting from the operation breaking this specification and user manual.

We will not send separate notice, provided that the contents of this specification are changed due to improvement of product quality or technological upgrading, if you want to understand the latest

information of this product, please contact us.

The shelf life of this product is within 60 months after it is delivered; we will maintain the product, which is in the warranty period for free of charge, if it has any product quality problems within the specified operation range, we may replace the relevant parts, if we fail to maintain it, To achieve the purpose of sustainable use without performance reduction, our after-sales service personnel will propose the specific maintenance and troubleshooting methods. In case of any questions, please contact us.

THANK YOU FOR CHOOSING
LET'S DEVELOP TRUST AND BUSINESS



Since 2003, BSLBATT provides electric energy more efficiently and reliably as the best solution.

Powerwall charges by day and powers at night for residential solar systems with compact, affordable, and easy installation features.

BSLBATT Battery - Solar

inquiry@bsl-battery.com

+86-752 2819 469



*8F, Building D-2-3, No. 6, Xingyuan North Road, Start-up Area, Zhongkai District, Huizhou City, 8F,
Building D-2-3, 1F, D-2-2 Building*